





BUILDING PERFORMANCE EQUIPMENT, INC.®

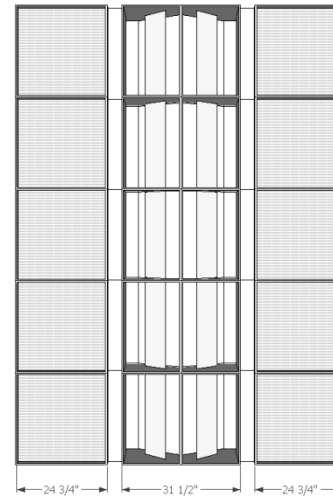

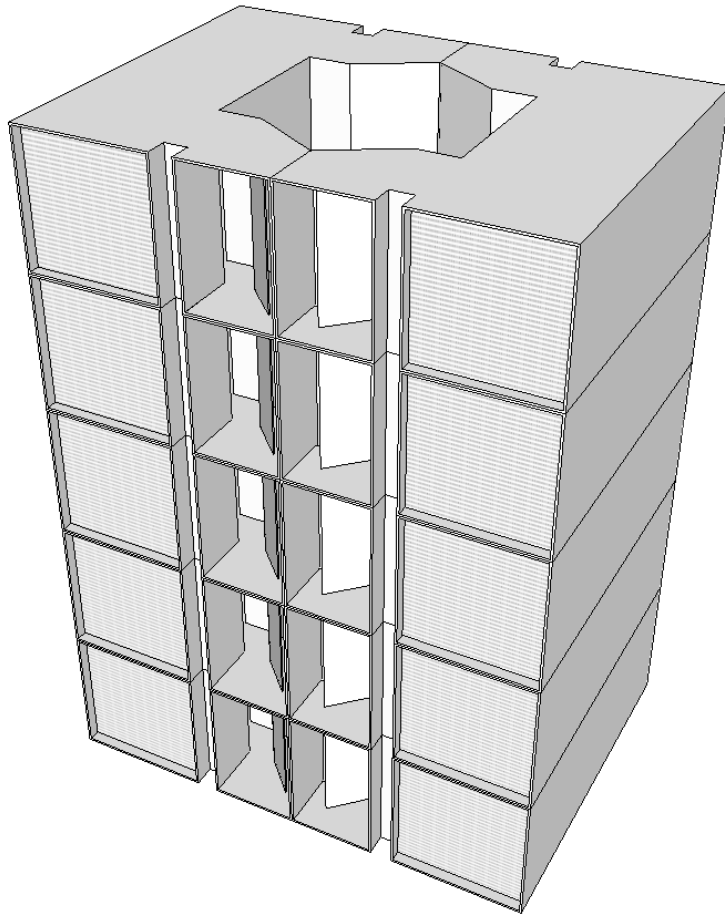

FRONT/BACK VIEW

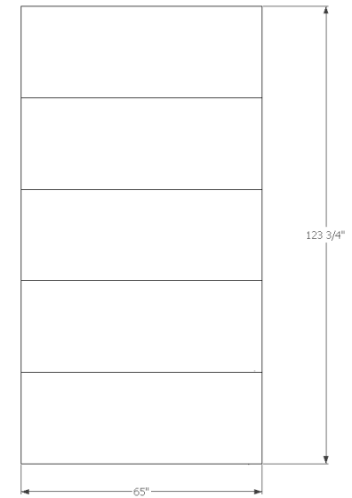

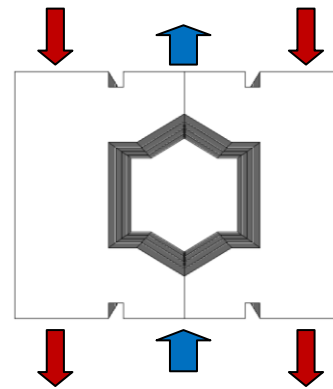SIDE VIEW



TOP/BOTTOM VIEW

 = Exhaust Air  
 = Outdoor Air

**HRV Weight:** 2,800 lbs  
**Tol/Clearances:** +/- 0.5 in  
 (Thermal Expan/Contr)



| REVISION RECORD |      |    |             | Modular ERV (100% OA)<br>Prairie HVAC   | DRAWN BY      | AHH       |
|-----------------|------|----|-------------|---|---------------|-----------|
| REV.            | DATE | BY | DESCRIPTION |   | ENG. APPROVAL | KCH       |
| 1               |      |    |             | <b>BPE</b><br>80 Broadway, Hillsdale, NJ 07642<br>Tel: (201) 722-1414   Fax: (201) 722-0999 | DATE          | 2/08/2012 |
| 2               |      |    |             |   | SCALE         | NTS       |
| 3               |      |    |             |   | SHEET NO.     | M-01      |